

**SLIP RESISTANCE
TEST REPORT**



Project : Slip Resistance Investigation
 Location of Test : Auckland Laboratory
 Client : Ecofloors Ltd
 Slider type : FOUR-S, Prepared on P 400 (or equivalent) sand paper.
 Specimen Description : Rubber Studded Tile (450x450mm)


Cleaning Procedure : Wet Brush
 Test Type : Unfixed
 Air Temp at Test (°C) : 22


Project Number : 1-LA346.00
 Lab Ref. Number : AL2215/2
 Client Ref. Number : Reg Hellesoe

SLIP RESISTANCE TEST RESULTS			
Test № :	Test Direction :	Mean BPN :	Mean Coefficient of Friction* :
1	N/A	18	0.17
2		17	0.16
3		16	0.15
4		17	0.16
5		16	0.15
Average :		17	0.16
Classification of pedestrian surface material in accordance with table 2, AS/NZS 4586:2004 :			Z

TEST METHOD

Tests were carried out in accordance with Appendix A, AS/NZS 4586:2004, the classification is based on a test in the wet condition.
 *Coefficient of friction obtained from: AS/NZS 3661.1 : 1993 Slip Resistance of Pedestrian Surfaces.

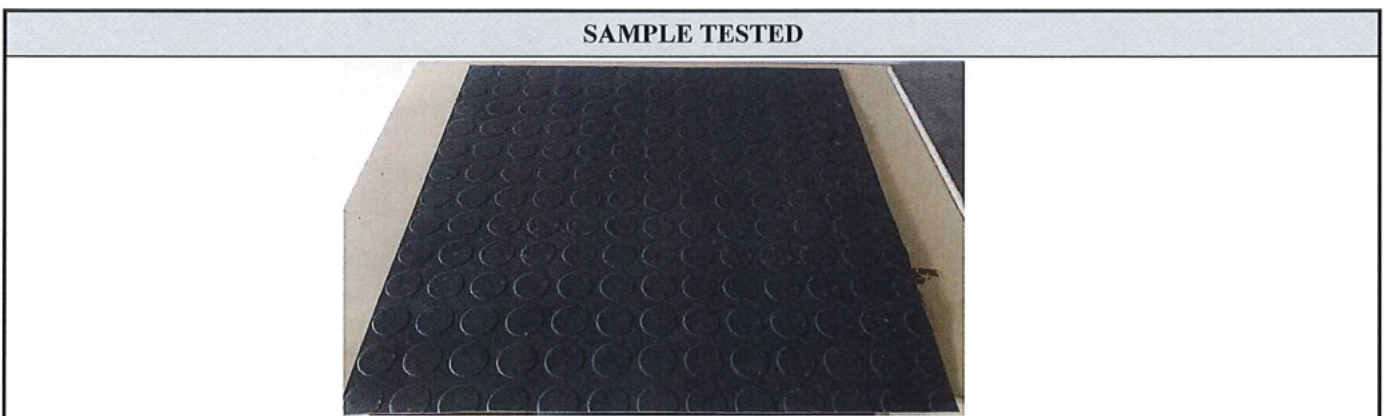

Tested By : 
 OPUS - K. Vashisht
 Designation : Civil Engineering Technician
 Date Tested : 10/01/18